

Paris Session 2022



Unlocking flexibility in the Netherlands





Study Committee C6
Preferential Subject 2
Question 2.4, on flexibility utilisation

Evert de Haan, the Netherlands

Normal grid operation

Congestion management

Full congestion

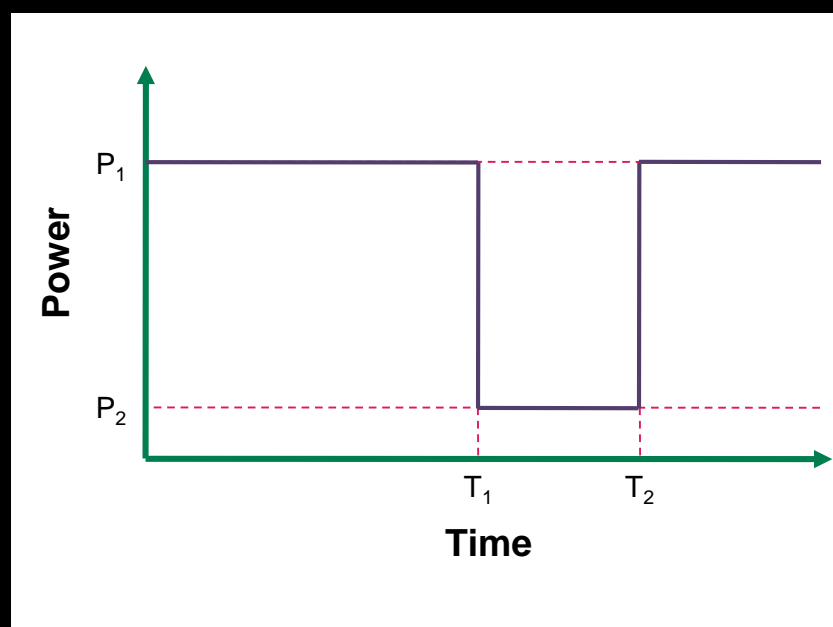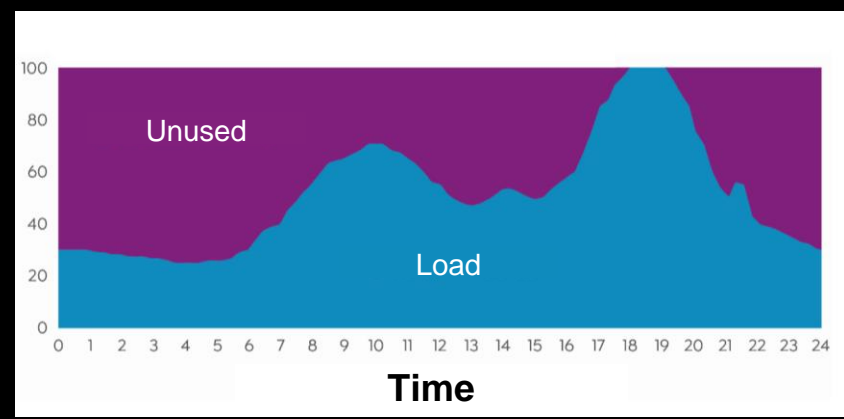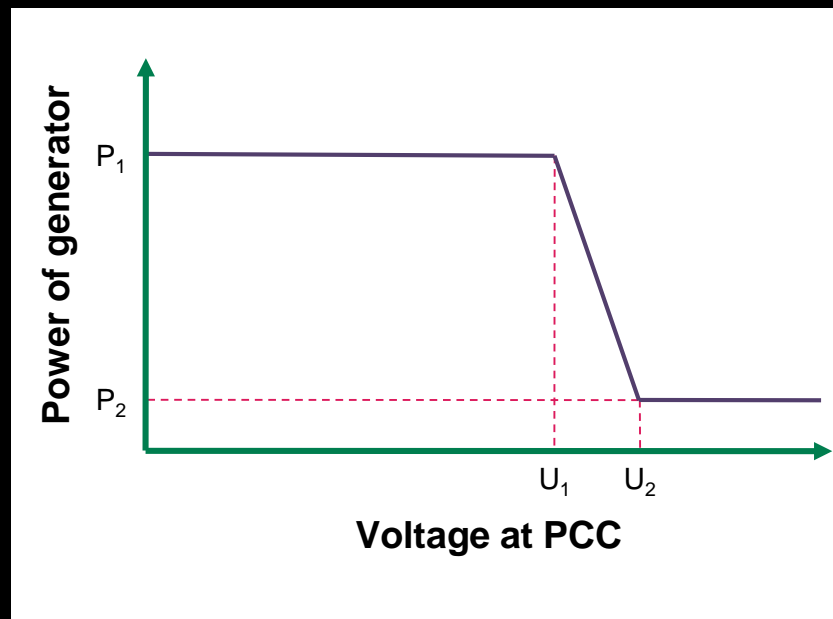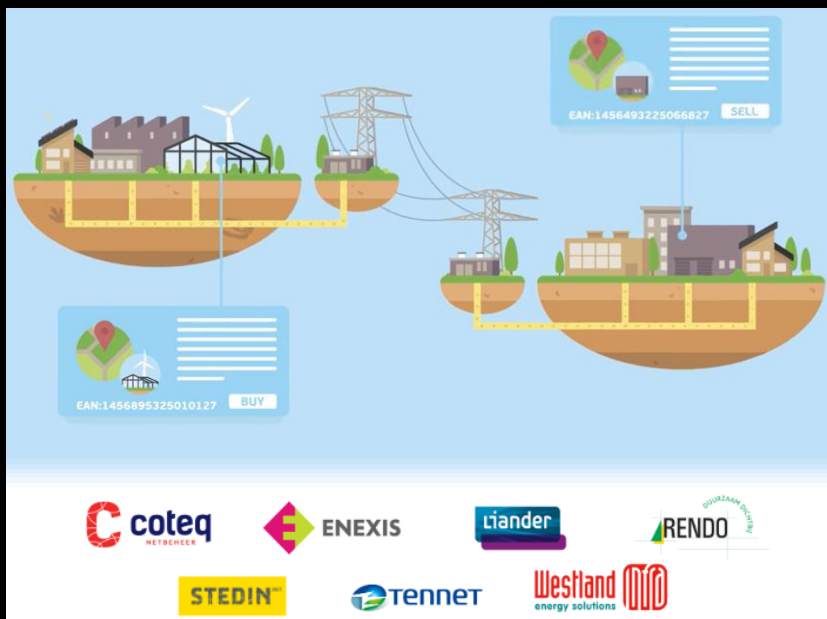

Right remuneration



Technically, we can make any flexibility product work

Tricky part: balanced financial incentives (no flexibility vs. not subsidising)

Sufficient supply



On a primary substation level, congestion management works

But supply is limited in MV and LV grids

Correct combination



Keep it simple: more flexibility products is not necessarily better